
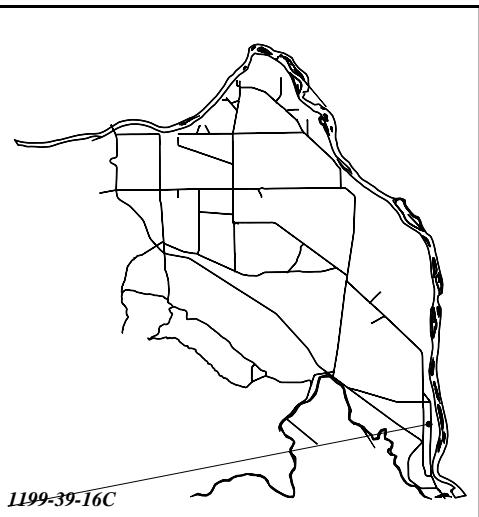




# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-1199-3099 WELL#=1199-39-16C

## RADIONUCLIDES

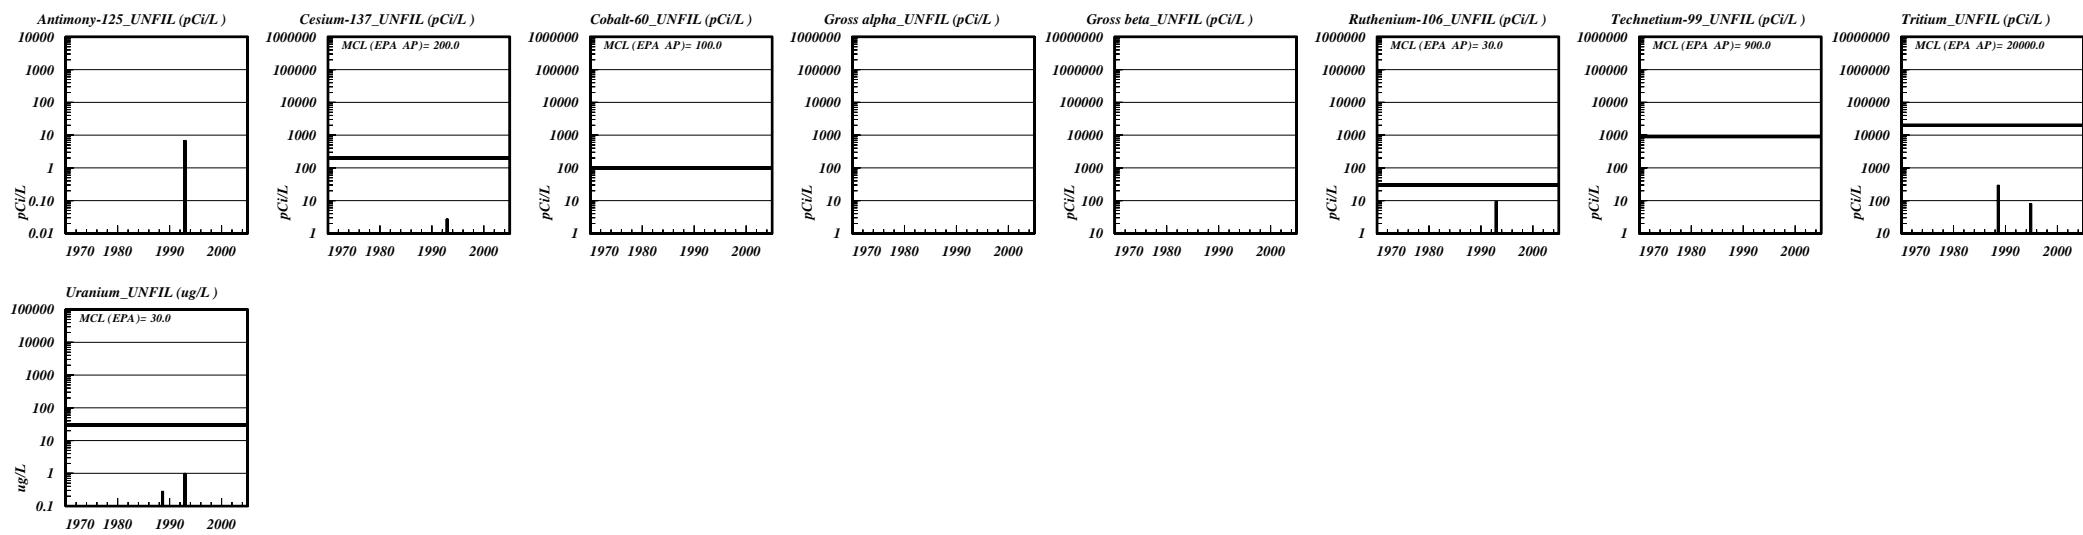

## VOLATILE ORGANIC COMPOUNDS

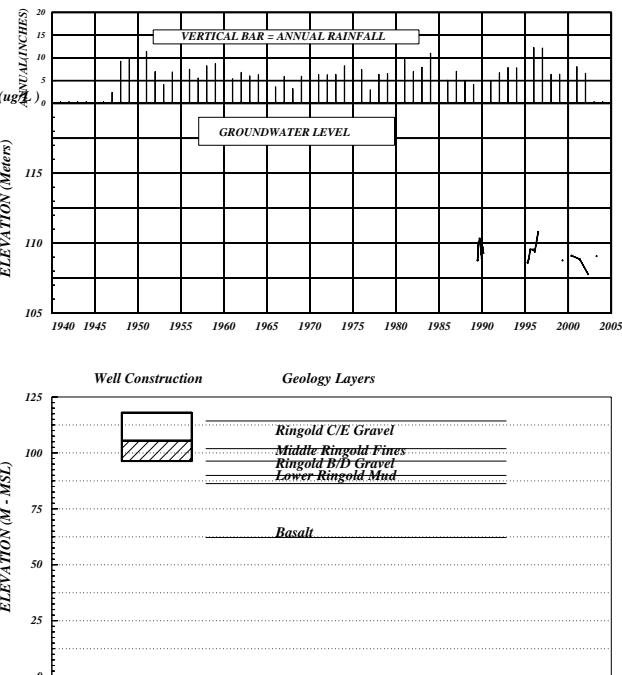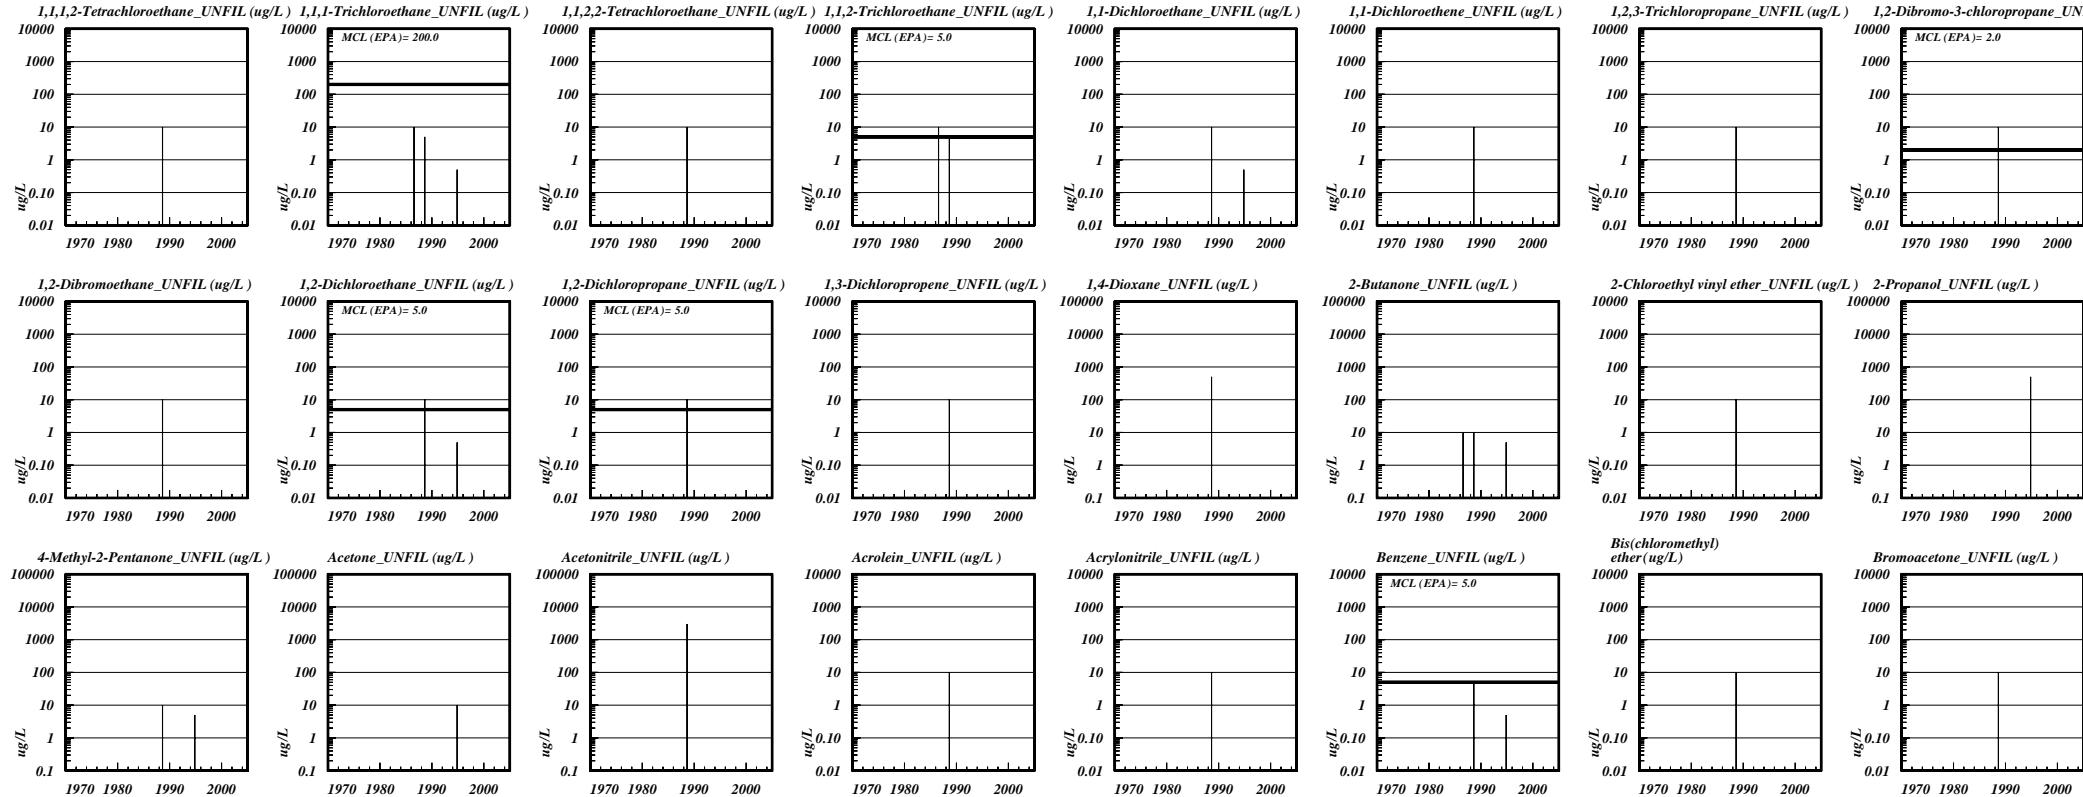

**WELLNAME=1199-39-16C WELLID=A9361**

Well Type=STANDARD Well purpose=RICHLAND  
 Owner=City of Richland Compliance=NON-COMPLIANT  
 X\_coor= 594291.70 Y\_coor= 111252.80 Datum=NAD83(91) Date Survey= 6/30/1995  
 Elevation= 118.003 Datum=NGVD29 Date Survey=05/02/95  
 Ref\_Point\_Desc=GROUND SHOT Ref\_Point\_side=SE Contractor=USACE(JECA)  
 Total Number of perforation Intervals=1  
 NPERF#=1 Perf\_top= 12.50 Bot= 21.64 mCas\_size= 20.00 in Perf\_cuts= 0.00


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-1199-3099 WELL#=1199-39-16C

## VOLATILE ORGANIC COMPOUNDS

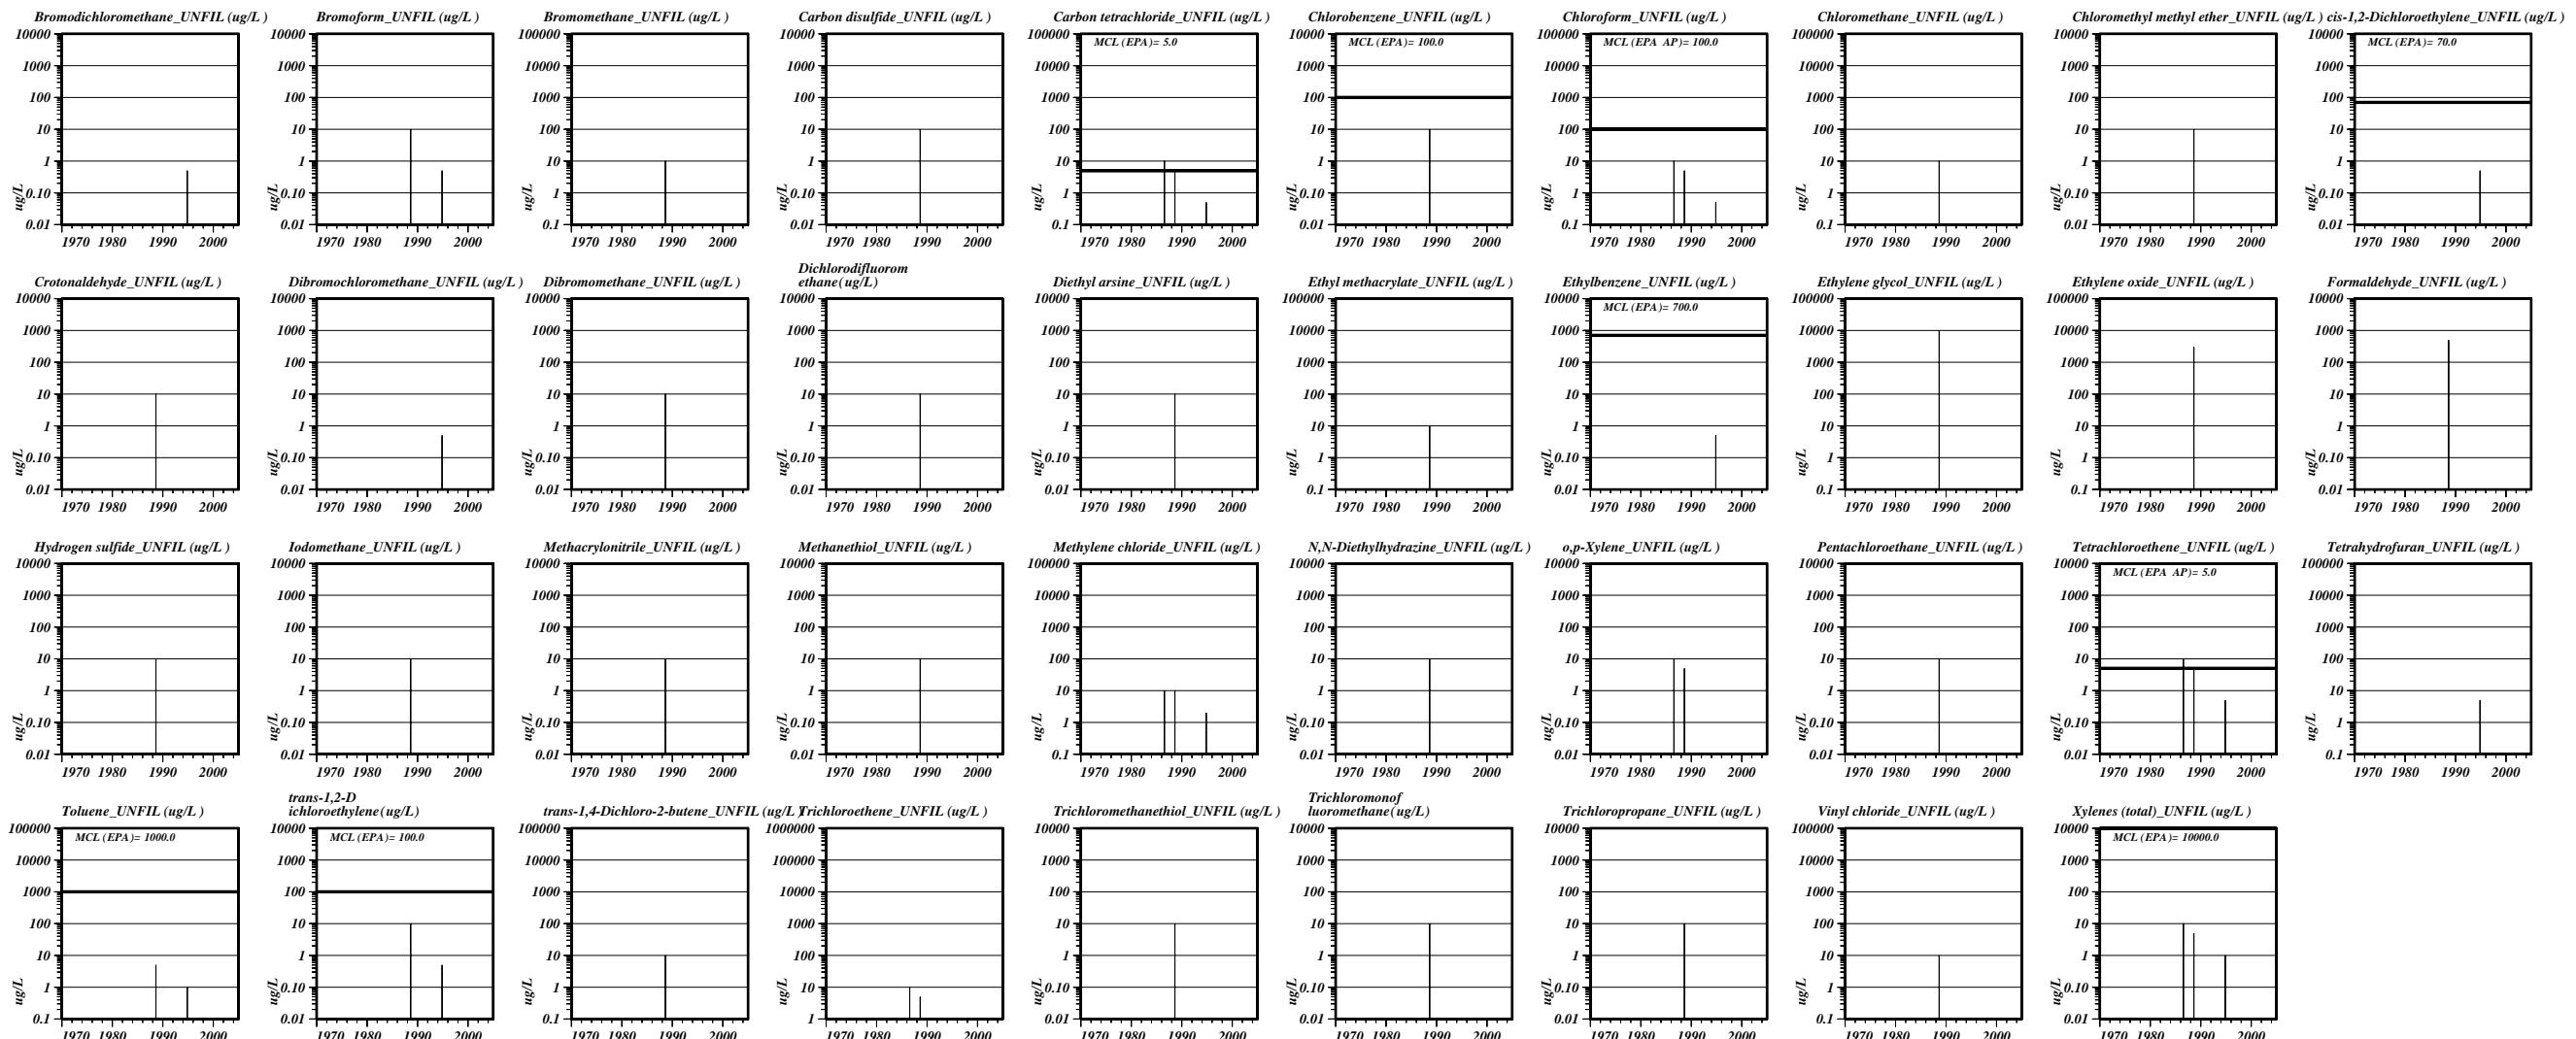

## SEMI-VOLATILE ORGANIC COMPOUNDS

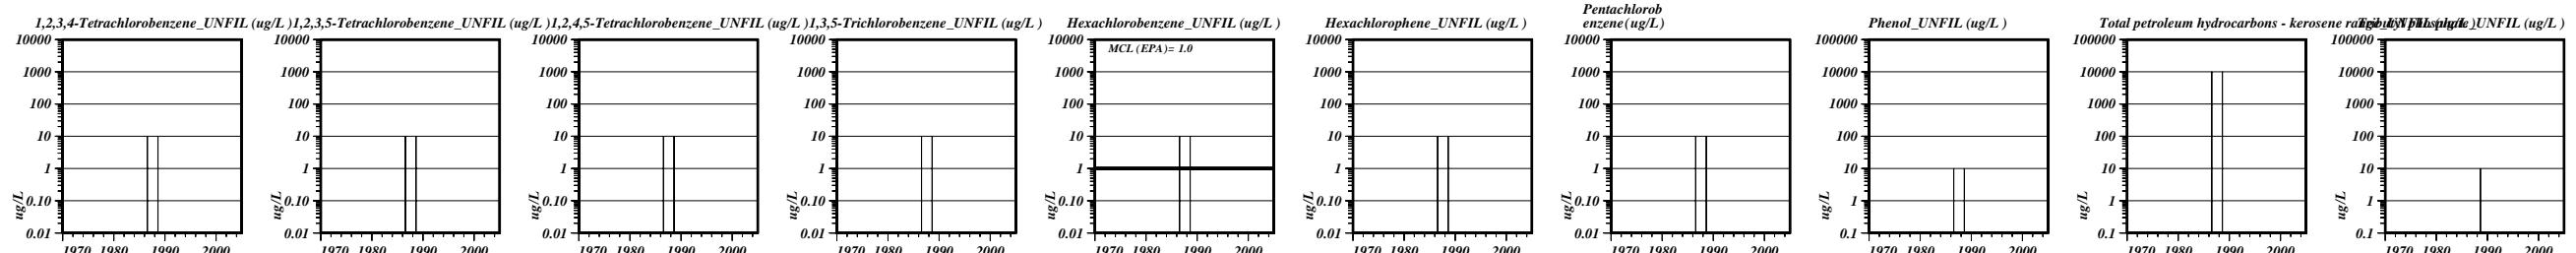


LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-1199-3099 WELL#=1199-39-16C

## METALS & PHYSICAL PARAMETERS

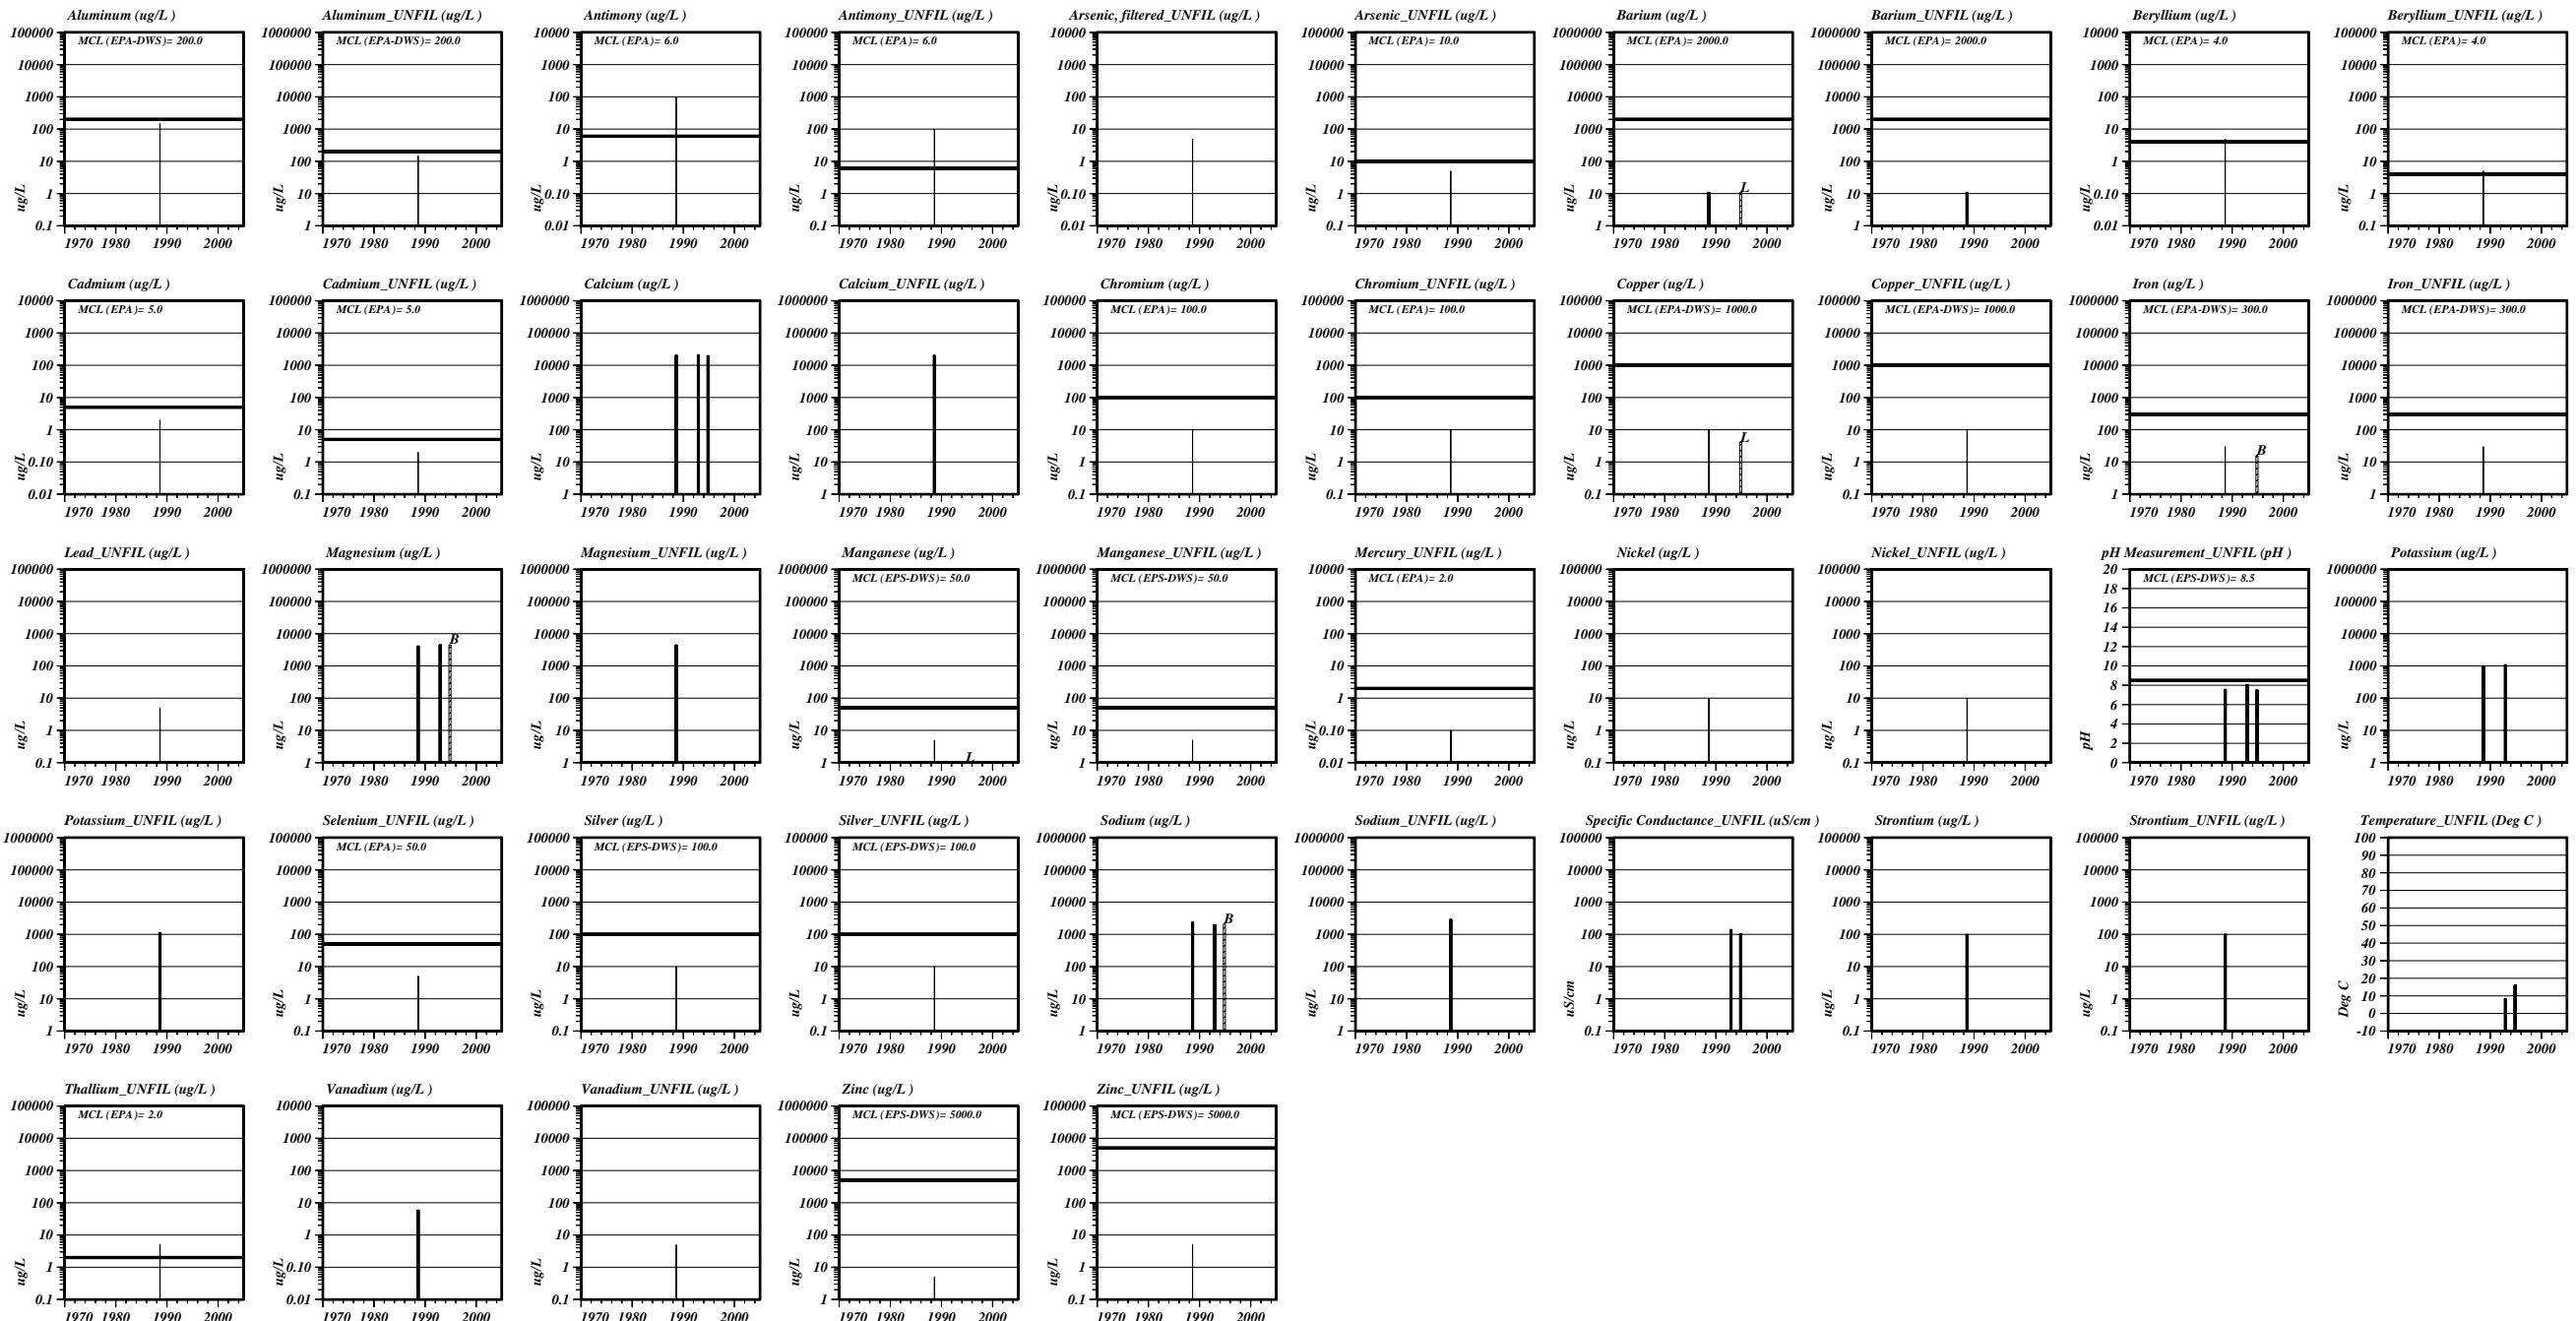


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-1199-3099 WELL#=1199-39-16C

## PEST/PCB, HERB, & DIOXINS

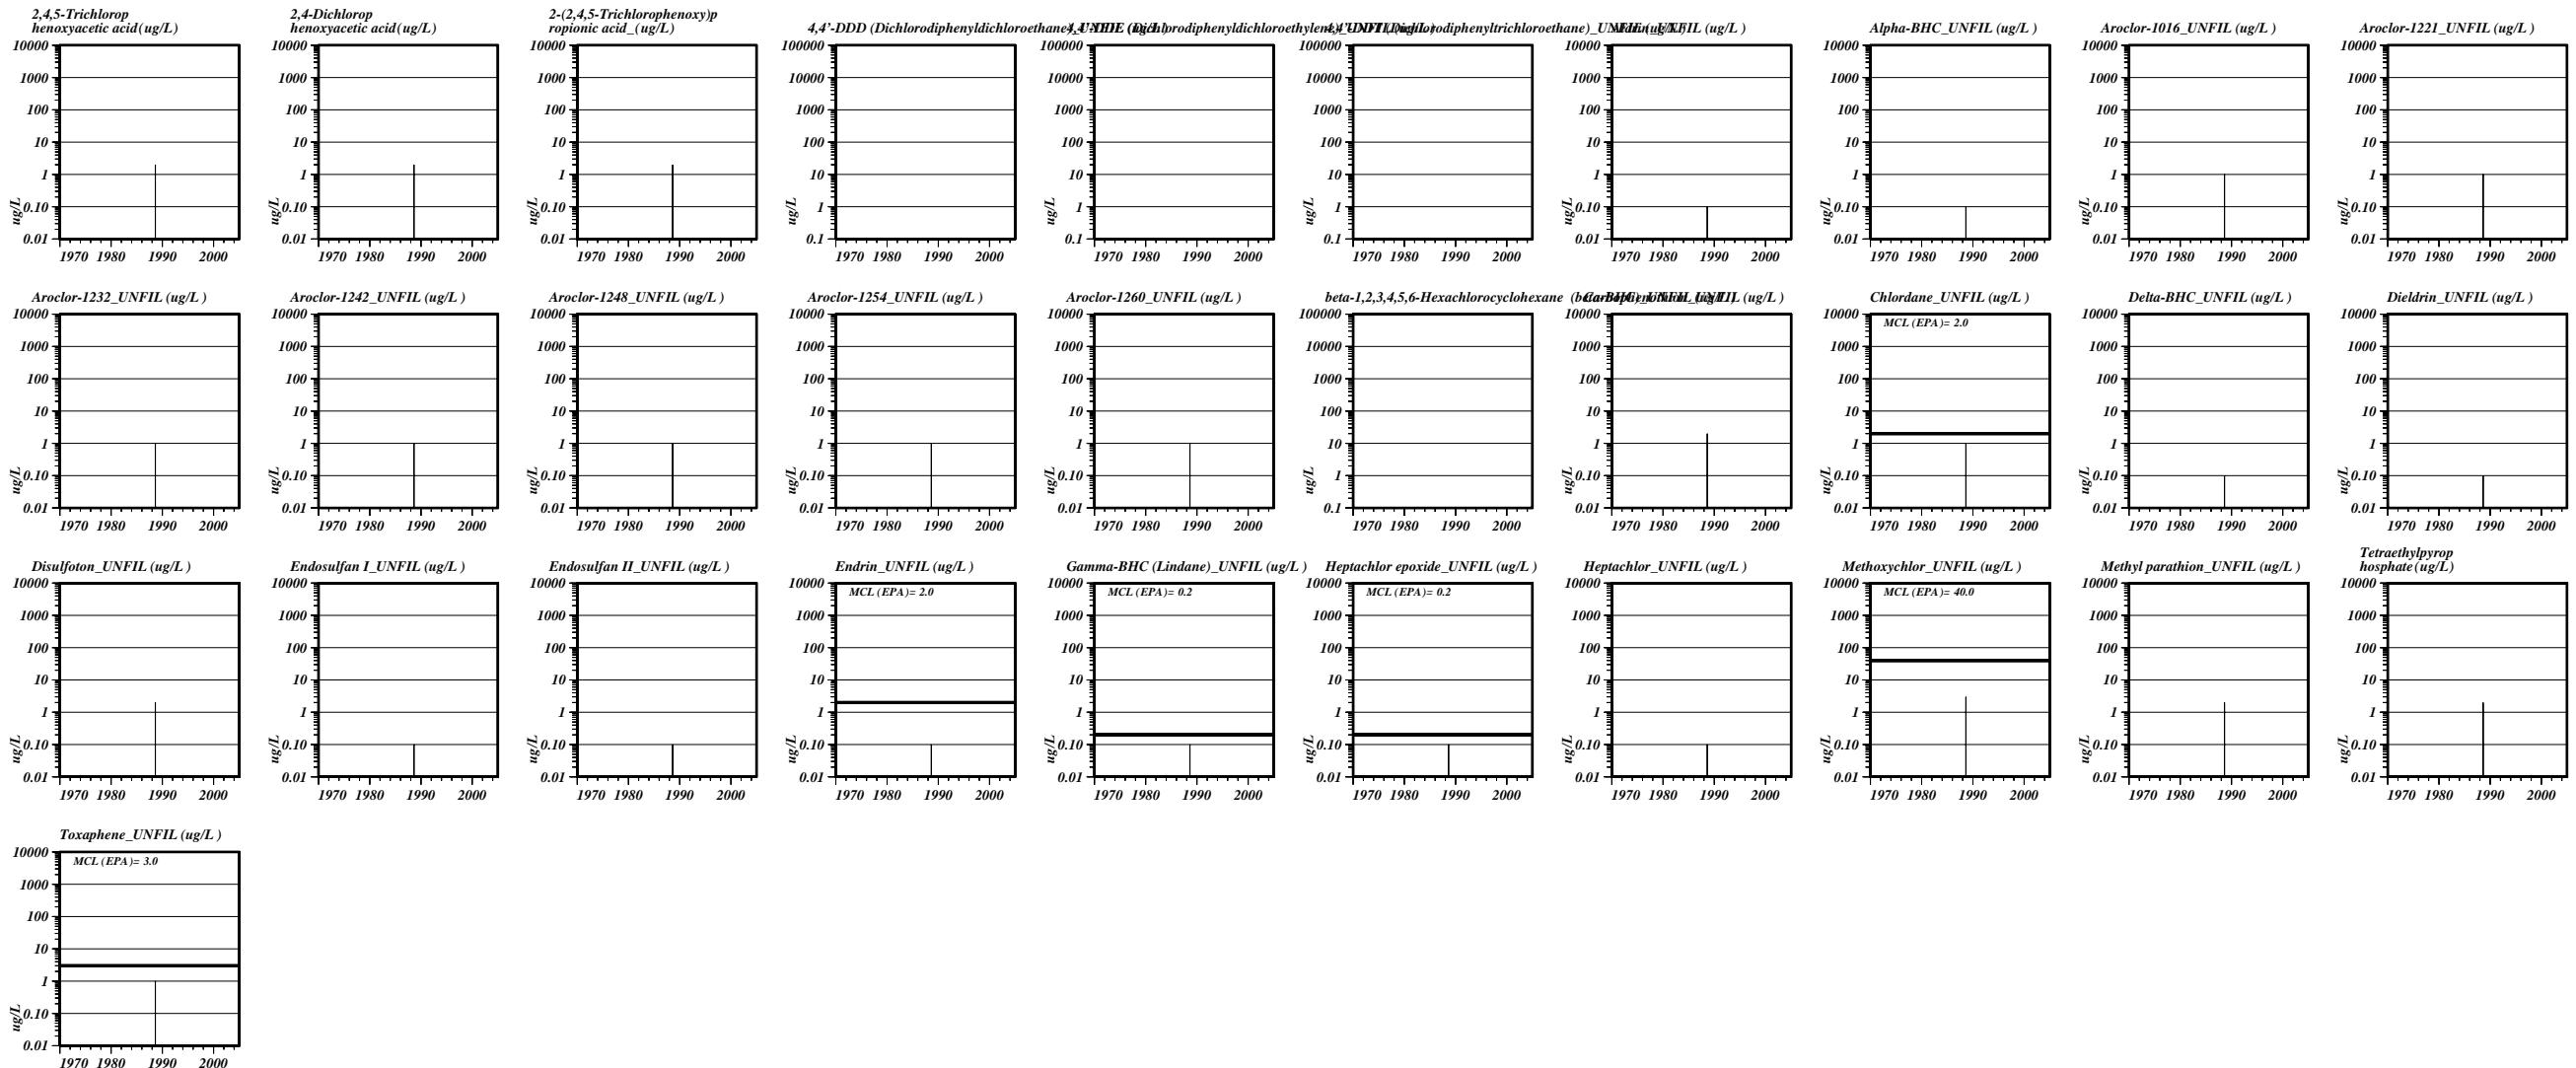

## GENCHEM & ORGANICS & GENORGANICS

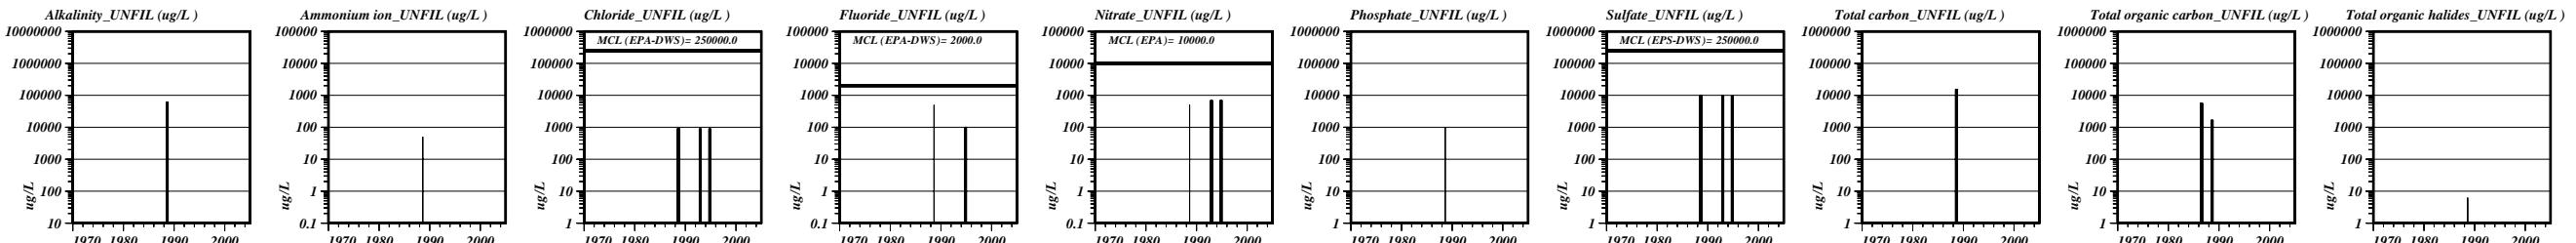

LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag